



3989 Highway 290 East
 Dripping Springs, Texas 78620
 512-858-2993

Client: Johnson City Crushed Stone
 Attn: Keith Jackson

Report No: 34632
 Date: 4/2/2021


Report of: Sieve Analysis for Coarse Aggregate
 Tex-401-A

Sample ID: Various
 Sampled By: Client
 Sample Location: NP
 Producer: Johnson City Crushed Stone
 Material Description: 57 Rock

Lab No: 210943-4
 Production/ Sampled Date: NP
 Project No: NP
 Received Date: 3/24/2021
 Test Performed By: Phillip New, CET

Results:

Sample No	1		2		Specification
Sample ID	Bucket 1		Bucket 3		
Sieve Size	Cumulative % Retained	Cumulative % Passing	Cumulative % Retained	Cumulative % Passing	Cumulative % Passing
1-1/2"	0.0	100.0	0.0	100.0	100
1"	2.7	97.3	1.3	98.7	95-100
1/2"	60.4	39.6	63.3	36.7	25-60
#4	99.1	0.9	96.1	3.9	0-10
#8	99.5	0.5	99.2	0.8	0-5

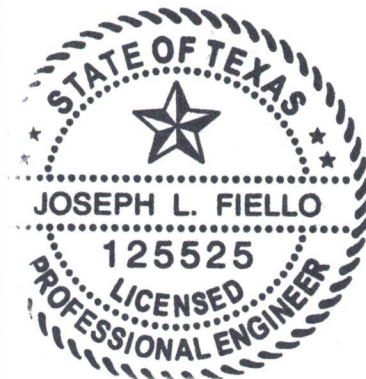

Reviewed by: Jo Fiello
 Atlas Technical Consultants LLC
 Firm Registration No. F-19813

The results shown on this report are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. Atlas Technical Consultants assumes no responsibility nor makes a performance or warranty statement for this material or products and processes containing the material connected to this report.